

OPERATING MANUAL

PROCESS TEMPERATURE CONTROLLER

PTC 9615RM

MISTURA

TECHNICAL SPECIFICATION

INPUT SPECIFICATION:

Sr.	INPUT		Range
1	TC-J		0 To 700 °C
2	TC-K		0 To 1300 °C
3	TC-T		0 To 350 °C
4	TC-R		0 To 1650°C
5	TC-S		0 To 1650°C
6	TC-E		0 To 650°C
7	TC-N		0 To 1250°C
8	PT		-100 To 400°C
9	PT-1		-100.0 To 400.0°C
10	0-10VDC		-1999 To 9999
11	0-5VDC		-1999 To 9999
12	4-20mA		-1999 To 9999
13	0-20mA		-1999 To 9999
Indication Accuracy		±1% of FSD ± 1°C (FSD: full scale deflection)	
Resolution		J,K,T,R,S,E,N,PT-100 = 1°C	
		PT.1 = 0.1°C	
		0-10V DC,0-5VDC,0-20mA DC,4-20mA DC = 0.1,0.01,0.001,0001	

OUTPUT SPECIFICATION:

Analog Output	
Controlling Output	4-20mADC/0-10VDC
Relay Output/ SSR Output (Factory Set)	
Relay/SSR	2
Relay Type	(NO-C)
Rating	Relay:10A, 230VAC/30V DC SSR: 12VDC,30mA
24VDC Transmitter supply & RS485 (Modbus)	

AUXILIARY SUPPLY:

Supply voltage	100 to 250V AC, 50-60Hz
Power consumption (VA RATING)	Approx. 7 VA @ 230V AC MAX


ENVIRONMENT CONDITION:

Operating Temp.	0°C to 55°C
Relative Humidity	UP to 95% RH (non-condensing)
Protection Level	IP-65 (Front side) As per IS/IEC 60529 : 2001



DIMENSION&DISPLAY:


Size	96(H) X 96(W) X 85(D)/ Cutout 92(H) X 92(W)
Display	Upper: 4 digit, 7 segment, 0.70" White Lower: 4 digit, 7 segment, 0.50" Green


MECHANICAL INSTALLATION

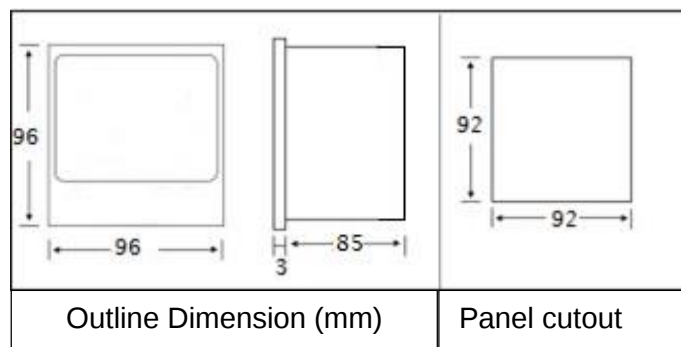


TERMINAL CONNECTION

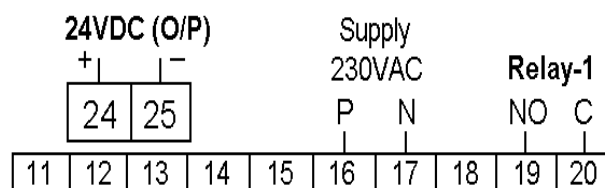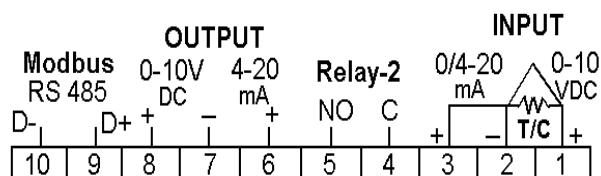

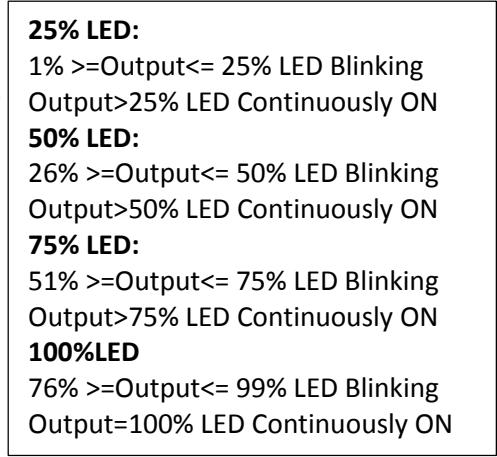


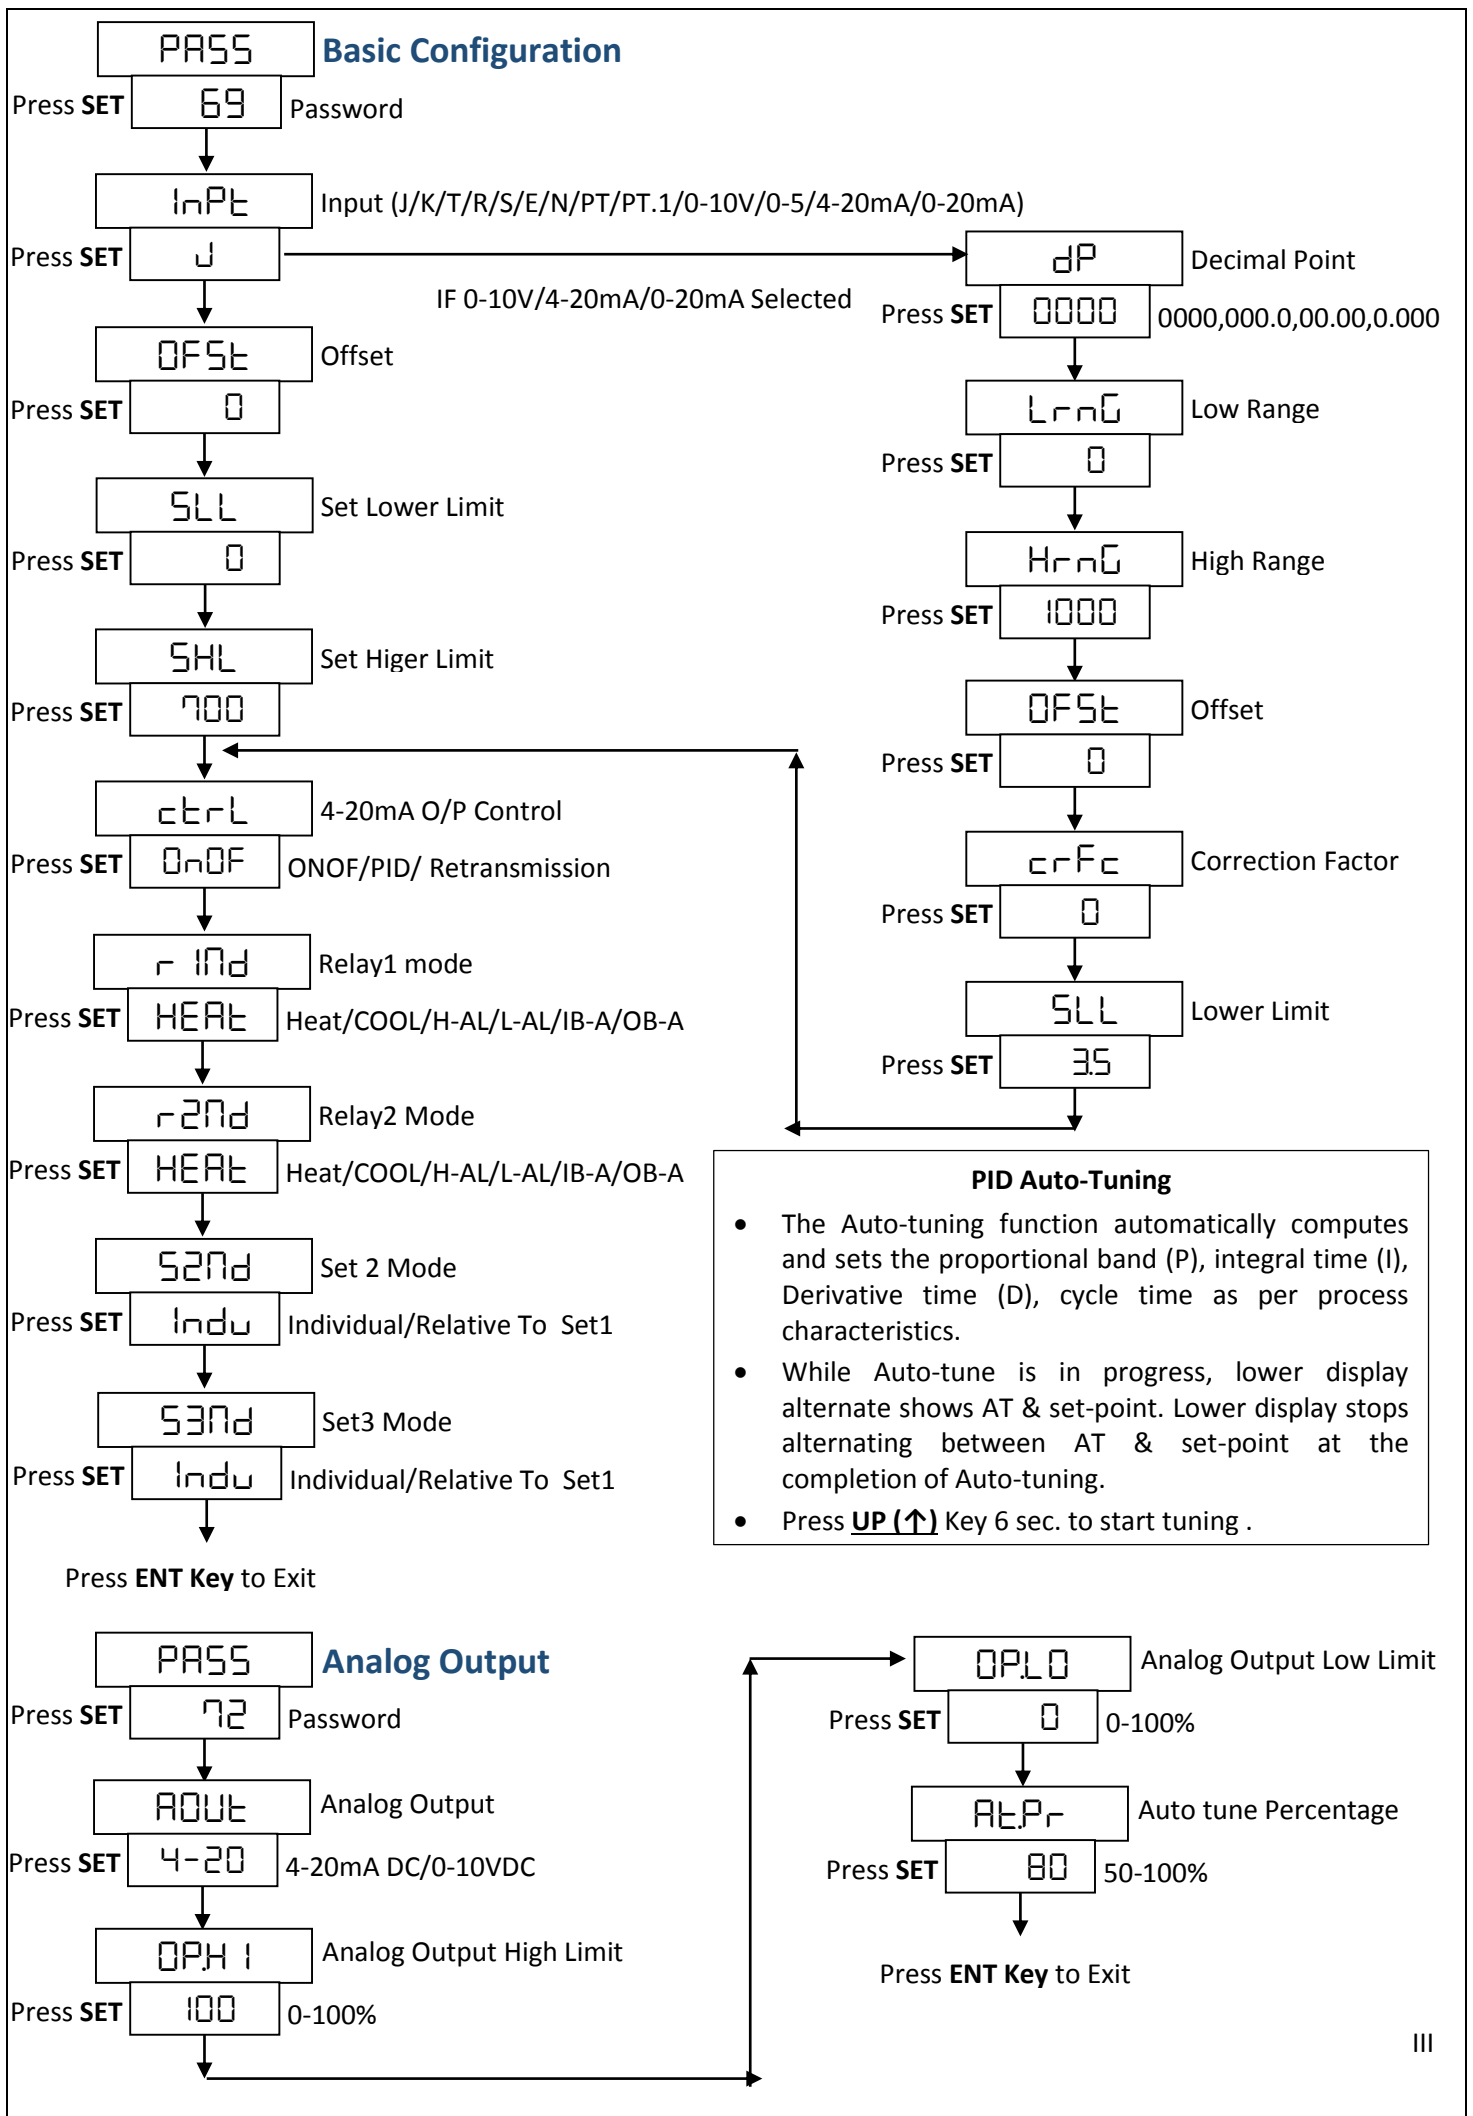

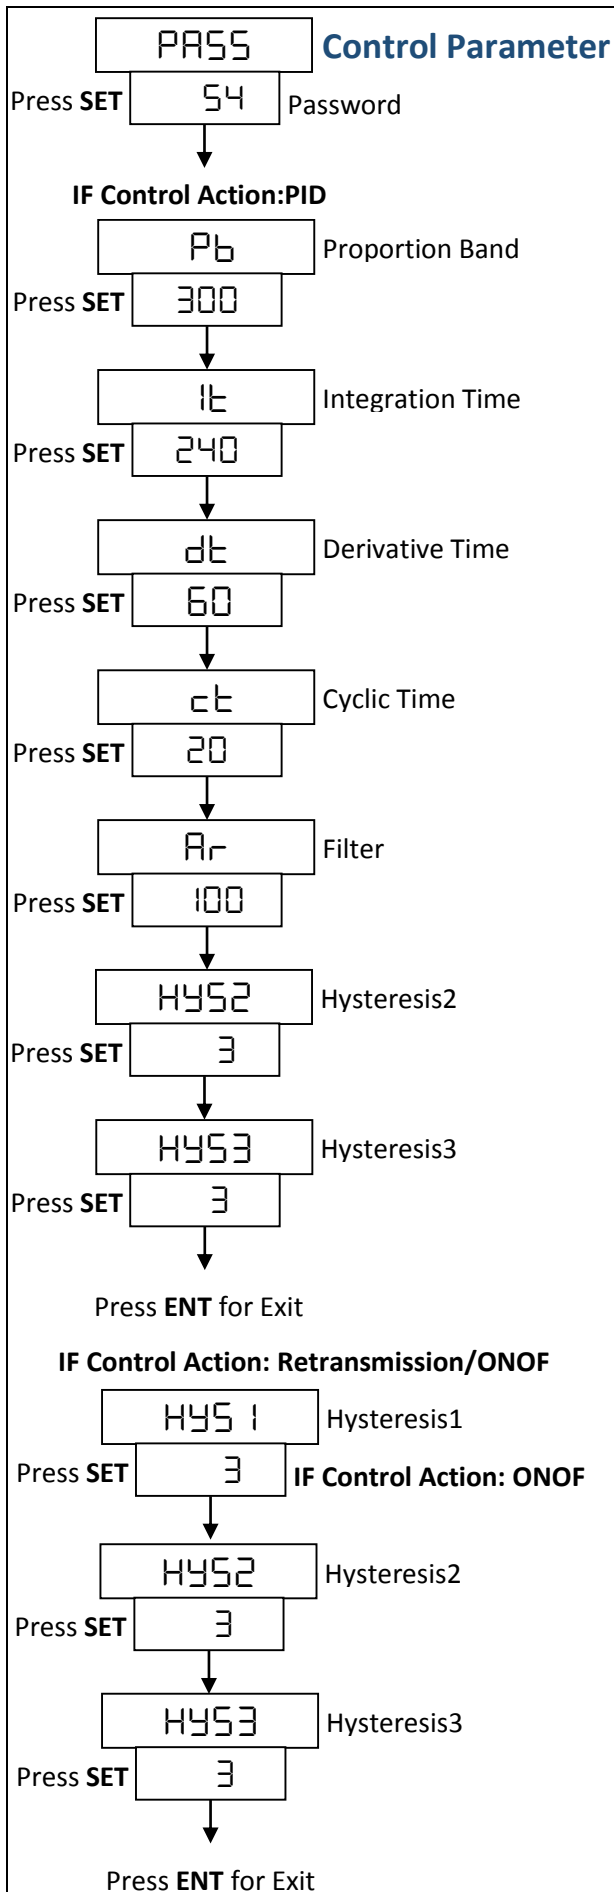


Relay1 & Relay2 Operating Modes

Heat Mode:

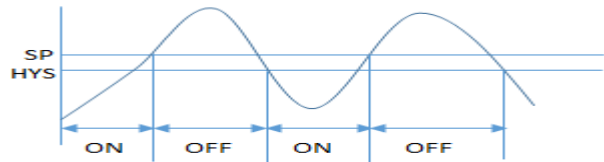


Initially Relay will be on condition. When Process value equals to Set Point Relay will turn off. When Process value equal to Set Point-Hysteresis then again Relay will be on.

Cool Mode:

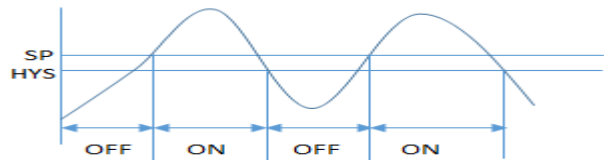


Initially Relay will be off condition. When Process value equals to Set Point Relay will turn on. When Process value equal to Set Point-Hysteresis then again Relay will turn off.

High Alarm Mode [H-AL]:

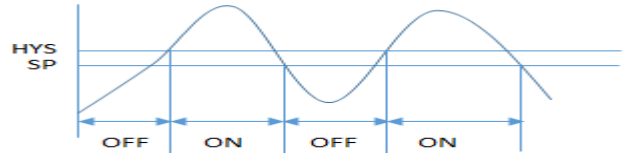


Initially Relay will be off condition. When Process value equals to Set Point + Hysteresis Relay will turn on. When Process value equal to Set Point then again Relay will turn off.

Low Alarm Mode [L-AL]:

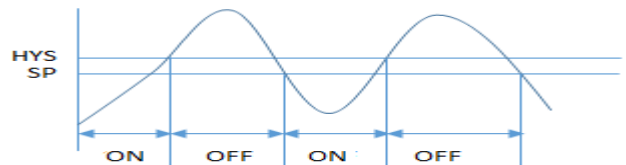


Initially Relay will be on condition. When Process value equals to Set Point + Hysteresis Relay will turn off. When Process value equal to Set Point then again Relay will turn on.

In Band Alarm Mode [IB-A]:

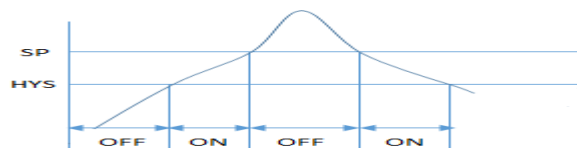

Relay will be on between Set point & Hysteresis condition. If Set Point=100 & Hysteresis=3 then Relay on between 97to100

Out Band Alarm Mode [OB-A]:

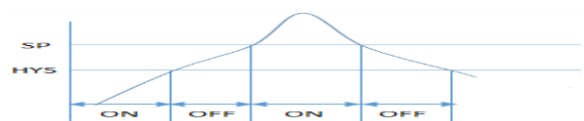

Relay will be off between Set point & Hysteresis condition. If Set Point=100 & Hysteresis=3 then Relay off between 97to100.

PASS

Modbus Parameter

Press SET

60

Password

SL. Id

Slave ID

Press SET

1

bAud

BuadRate

Press SET

9600

9600/19.2K

Prty

Parity

Press SET

NONE

None/Even/Odd

Press ENT for Exit

Data type = Sign Integer show value as per following

Input	Actual Value	DP Selection
J/K/T/R/S/E/N/PT	Value/1	Fix
PT.1	Value/10	Fix
0-10VDC	Value/1	0
4-20mA DC	Value/10	1
0-5VDC	Value/100	2
0-20mA DC	Value/1000	3

Read/Write	Parameter	Read Function Register(0x03/0x04) ADDRESS(INT)	Write Function Register (0x06/0x10) ADDRESS(INT)
R	Process Value	40001/30001	-
R/W	Set Value1	40002/30002	40002
R/W	Set Value2	40003/30003	40003
R/W	Set Value3	40004/30004	40004
R/W	Retransmission Low Value	40005/30005	40005
R/W	Retransmission High Value	40006/30006	40006
R/W	Input*	40007/30007	40007
R/W	Lower Range(0-10V,4-20mA)	40008/30008	40008
R/W	Higher Range(0-10V,4-20mA)	40009/30009	40009
R/W	OFFSET	40010/30010	40010
R/W	CRFC(0-10V,4-20mA)	40011/30011	40011
R/W	SSL	40012/30012	40012
R/W	SHL	40013/30013	40013
R/W	4-20 Output Action*	40014/30014	40014
R/W	Relay1 Mode*	40015/30015	40015
R/W	Relay2 Mode*	40016/30016	40016
R/W	Hysteresis1	40017/30017	40017
R/W	Hysteresis2	40018/30018	40018
R/W	Hysteresis3	40019/30019	40019

*INPUT (Range: 0-12) 0:TC-J, 1:TC-K, 2:TC-T, 3:TC-R, 4:TC-S, 5:TC-E, 6:TC-N, 7:PT, 8:PT.1, 9:0-10V, 10:0-5V, 11: 4-20mA, 12: 0-20mA

*4-20 Output Action (Range: 0-2) 0: ONOF, 1: PID, 2: Retransmission

*Relay1/2 Mode (Range: 0-5) 0:HEAT,1:COOL,2:H-AL,3:L-AL,4:IB-A,5:OB-A